NVC Display Kit Installation Guide

The NVC control board kit (K331003) is a replacement display for the Natural Ventilation Control. Follow the instructions in the order they are listed to replace the display.

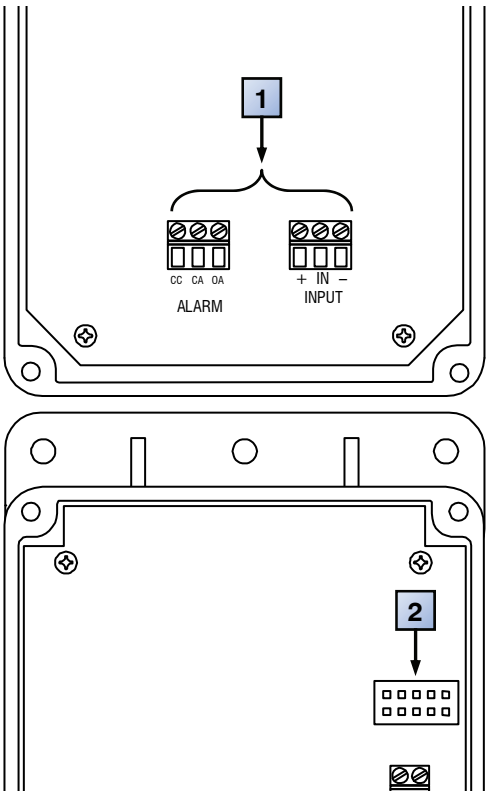

Before installing the kit or servicing the control, switch OFF the power at the source.

1 **Connection terminals:** label the wires connected to each terminal *on the display only*, and then disconnect them from the terminals.

2 **Display connector:** disconnect the ribbon cable and remove the display. After connecting the wires to the terminals on the new display, connect the ribbon cable to the base.

NOTE After replacing the display, you will need to reprogram the NVC control.

Removing the old display

1. Switch off the power to the NVC.
2. Remove the cover from the unit.
3. Label and remove the wires connected to the terminals *on the display only*.
4. Disconnect the ribbon cable from the base.

Installing the new display

1. Remove the new display from the bag.
2. Connect the wires to their correct terminals.
3. Connect the ribbon cable to the socket.
4. Verify all the wires are properly connected to their correct locations.
5. Switch on the power to the control.
6. Reprogram the control
7. Verify the control operates properly. If it does not operate properly, check the wiring and ribbon cable connection. If the unit still will not operate properly, contact your dealer.
8. Fasten the cover to the enclosure using the four screws.

Phason Inc.
2 Terracon Place
Winnipeg, Manitoba, Canada
R2J 4G7

Phone: 204-233-1400
Fax: 204-233-3252

E-mail: support@phason.ca
Web site: www.phason.ca