Procedure overview

1. Shut down AutoFlex Connect
2. Remove the old communication controller
3. Install the new

Shut down AutoFlex Connect

Before installing the kit or servicing the control, switch OFF the incoming power at the source.

1. On the Diagnostics screen, swipe right or left until you see the Shut Down Display icon.
2. Press **Shut Down Display**.
   The control goes through a shutdown process. When the message "*It is now safe to turn off the control.*" displays, you can go to the next step.
3. Open the cover of the AutoFlex Connect.
4. Switch off the power using the switch on the bottom board.

Mini

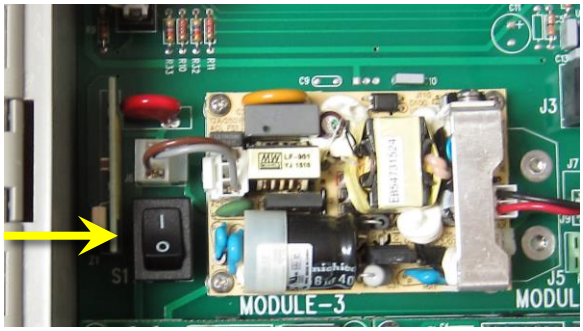

Regular

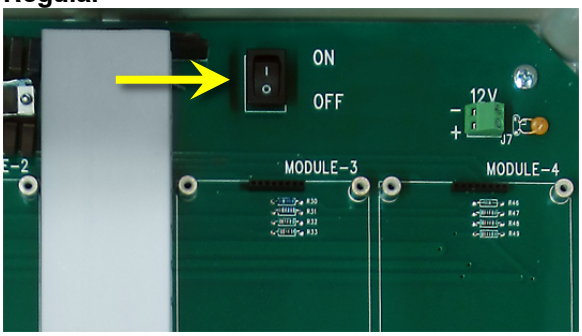

5. Wait for the red light on the controller board to go completely off. This can take from 3 to 5 minutes.

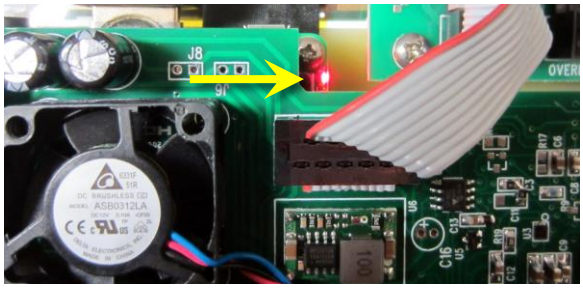

Remove the old communication controller

1. Make sure the red light in step 5 from the previous section is off.
2. Unplug the two ribbon cables (**A**).
3. If connected, label and then remove the alarm wiring from the ALARM terminal block (**B**).
4. Remove the five screws (**C**) the circuit board.
5. Carefully remove the circuit board.

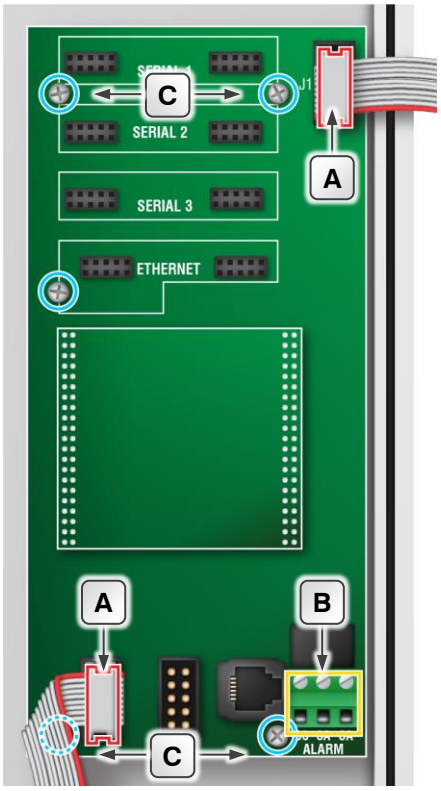

Install the new communication controller

1. Remove the new communication controller from the packaging.
2. Plug the two ribbon cables into their connectors.
3. If you have alarm wiring, reconnect it to the ALARM terminal.
4. Verify all cables and wires are properly connected to their correct locations.
5. Switch on the power to the control and verify it operates properly. If it does not, check the wiring and cable connections. If it still will not operate properly, contact your dealer.

NOTE

After replacing the communication controller, Phason recommends that you check for and install any available updates.

Phason Inc.
2 Terracon Place
Winnipeg, Manitoba, Canada
R2J 4G7

Phone: 204-233-1400
Fax: 204-233-3252
E-mail: support@phason.ca
Web site: www.autoflexcontrols.com